

ALCO's TX3 series of Thermo®-Expansion Valves are designed for air conditioning, heat pumps and commercial refrigeration applications. The TX3 is ideal for those applications requiring hermetic / compact size combined with stable and accurate control over wide load and evaporating temperature ranges.

**Features**

- Compact size
- Hermetic design
- Nine sizes up to 23kW
- Brazing connections with straight through configuration
- Stainless steel power element resists corrosion
- Large diaphragm provides smoother and consistent valve control
- Internal or external equalizer
- External superheat adjustment
- Version with internal check valve eliminates external check valve for heat pump applications
- Packaging units with 24 pieces, no single packs

**Options**

- Metric connections upon request
- Bleed function, minimum order quantity 100 pieces per batch and type

**Introduction**

Thermo®-Expansion Valves control the superheat of refrigerant vapour at the outlet of the evaporator. They act as a throttle device between the high and low pressure sides of refrigeration system and ensure the rate of refrigerant flow into the evaporator exactly matches the rate of evaporation of liquid refrigerant. Thus the evaporator is fully utilized and no liquid refrigerant may reach the compressor.

When the actual superheat is higher than the setpoint, thermo® expansion valve feeds the evaporator with more liquid refrigerant when the actual superheat is higher than the set point of the valve. Likewise, the valve decreases the refrigerant flow to the evaporator when the actual superheat is lower than the set point.

**Description of bulb charges**

The application ranges of thermo® expansion valves are heavily influenced by the selected charge.

**Liquid charges**

The behaviour of Thermo®-Expansion Valves with liquid charges is exclusively determined by temperature changes at the bulb and not subject to any cross-ambient interference. They feature a moderate response time and thus stabilize the control circuit. Liquid charges **cannot incorporate MOP functions**.



**TX3**

The maximum bulb temperatures shall not exceed the values in the following table:

Refrigerant	Maximum bulb temperature	
	TX3	TX3 with internal check valve
<b>R 134a</b>	88°C	-
<b>R 22 / R 407C</b>	71°C	120°C
<b>R 404A / R 507</b>	66°C	-
<b>R 410A</b>	66°C	-

**Table 1:** This table refers to the maximum dehydration temperature when the bulb and valve body are subjected to the same temperature.

TX3 with internal check valve are suitable for heat pump applications and incorporate special liquid charges and ballasted bulbs. Ballast in the bulb leads to slow opening and fast closure of the valve. Maximum bulb temperature is 120 °C.

**Gas charges**

The behaviour of thermo® expansion valves with gas charges will be determined by the lowest temperature at any part of the expansion valve (power assembly, capillary tube or bulb). If any parts other than the bulb are subject to the lowest temperature, malfunction of the expansion valve may occur (i.e. erratic low pressure or excessive superheat). ALCO TX3 valves with gas charges **always feature MOP functions** and include ballasted bulbs. Ballast in the bulb leads to slow opening and fast closure of the valve. Maximum bulb temperature is 120 °C.

**MOP (Maximum Operating Pressure)**

MOP functionality is somewhat similar to the application of a crankcase pressure regulator. Evaporator pressures are limited to a maximum value to protect compressors from overload conditions.

MOP selection should be within maximum allowed low pressure rating of the compressor and should be at approximately 3 K above maximum evaporating temperature.

MOP (bar)	Upper limit of evaporating temperature					
	R 134a	R 22	R 407C	R 404A	R 410A	R 507
2.3				-18°C		-18.7°C
3.3	+11°C					
6.4		+13°C	+14.5°C			
12.9					+17°C	

**Table 2:** (All pressures are gauge pressure)

**Bleed function**

In systems with some type of single phase compressor (such as permanent split capacitor motor, small rotary compressor etc.), it is necessary to provide some means of equalization between high and low side pressure during “off” cycle, so that the motor of compressor can start with minimum torque.

The required bleed hole size for a particular system is a function of the high side and low side volumes, the pressure difference across the valve at the time of shut-down, the required equalization time and the amount of refrigerant charge.

Due to the many variables, each application must be tested to determine the correct size of bleed hole. It should be remembered that bleed hole size adds to the total effective port area of the TXV and may affect size of valve. Final selection of bleed hole size should be made only after thorough testing.

**Practical hints:**

Superheat adjustments influence the MOP:

- Increase of superheat: Decrease of MOP
- Decrease of superheat: Increase of MOP

**Subcooling**

Subcooling generally increases the capacity of refrigeration system and may be accounted for when dimensioning an expansion valve by applying the correction factor  $K_t$ .

The capacity corrections for evaporating temperature, condensing temperature and subcooling are all incorporated in  $K_t$ . These are in particular the liquid density upstream from the expansion valve, the different enthalpies of liquid and vapour phase refrigerants as well as certain part of flash gas after expansion. The percentage of flash gas differs with various refrigerants and depends on system conditions.


Heavy subcooling results in very small flash gas amounts and therefore increases expansion valve capacities. These conditions are not covered by  $K_t$ . Likewise, small flash gas amounts lead to reduced evaporator capacities and may result in substantial discrepancies between the capacities of the thermo® expansion valve and the evaporator.

These effects must be considered during component selection when designing refrigeration circuits. In cases when subcooling exceeds 15 K sizing of components ( $K_t$ ,  $K_{Ap}$ ) shall be modified accordingly. ALCO CONTROLS will be happy to assist you. Please contact our application engineering department.

**Heat pump applications**


There are several ways to apply an expansion valve in a heat pump:

**1) Thermo-Expansion Valves with internal check valves**

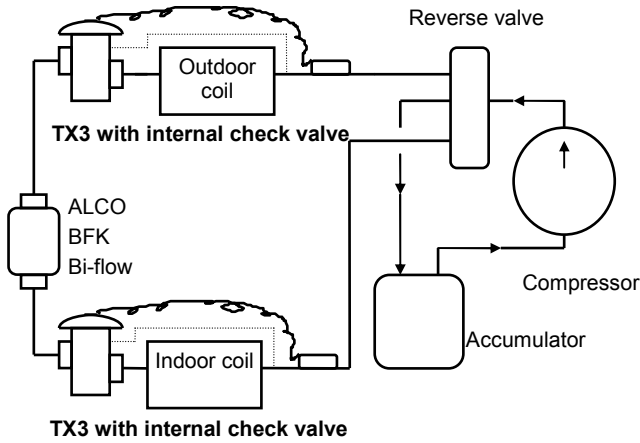


This system is very simple because TX3 expansion valves with integrated check valves have been used. ALCO TX3 with internal check valve and special liquid charge is ideal for use in heat pump applications.

**2) Thermo-Expansion valves with external check valves**

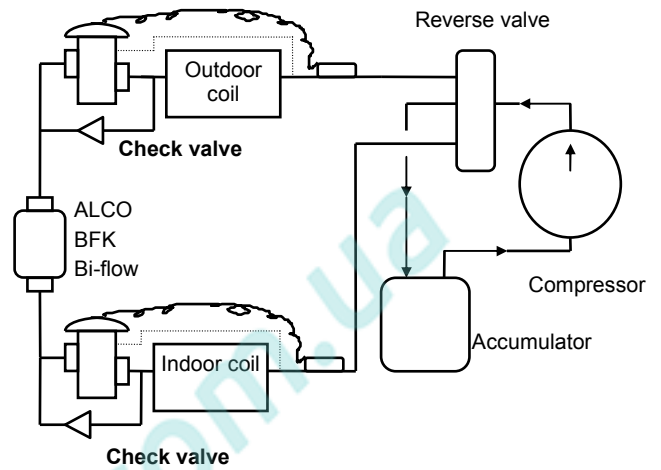


This type of system employs two expansion valves and two check valves. In this type of application, the charge of expansion valves should be able to withstand the high temperatures during reverse flow.

Expansion valves with gas charge are not recommended in heat pumps with automatic operation between heating and cooling mode due to the cross ambient effect on TXV after reversing flow direction.

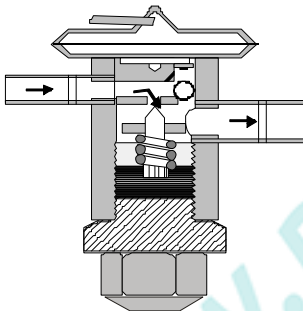


TX3 with internal check valve in normal flow

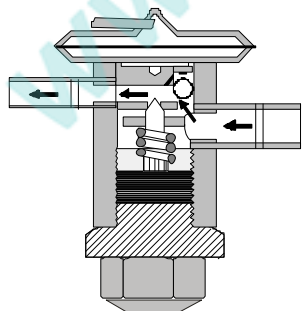

TX3 with internal check valve in reverse flow

**3) The TX3 are not designed to operate in Bi-flow accordance to the following circuit**

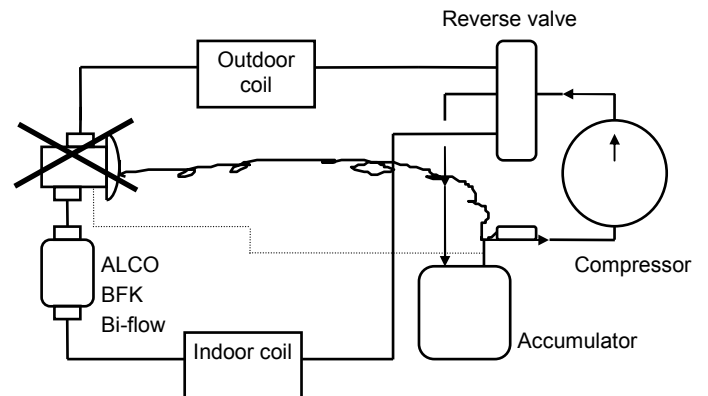

Please contact ALCO CONTROLS for applications requiring Thermo® Expansion Valves with Bi-flow capability.


**Superheat**

The factory setting of TX3 is made with the valve pin just starting to move away from seat. The superheat increment necessary to get the pin ready to move is called static superheat (SS). A superheat increment over and beyond the static superheat (factory setting) is necessary for the valve pin to open to its rated capacity. This additional superheat is known as gradient or opening superheat (OS).

The working superheat, which can be measured in field, is the sum of static superheat and opening superheat (WS).

The opening superheat of TXV varies if the selected valve operates at higher or lower capacities than rated capacity. It is highly recommended to select the valve according to the rated capacity. Using reserve capacity leads to larger opening superheat and longer pull down time during start-up or after defrost.

Selecting a larger valve than required in system may lead to smaller opening superheat and/or hunting of TXV.

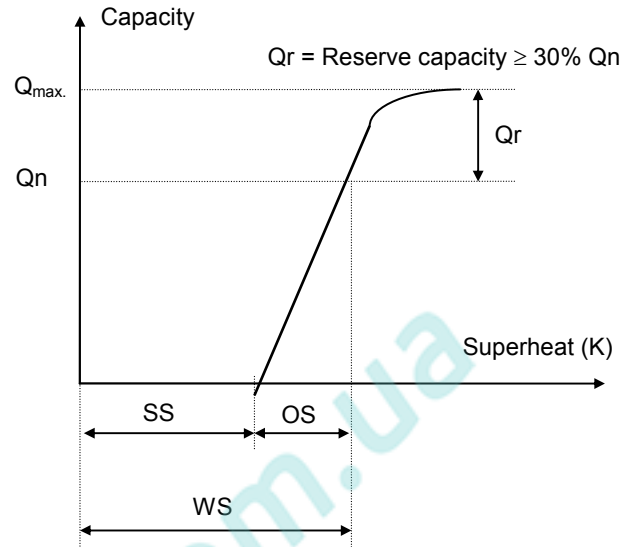

**Static superheat setting**

ALCO Thermo®-Expansion Valves are factory preset for optimum superheat settings. This setting should be modified only if absolutely necessary. The readjustment should be at the **lowest** expected evaporating temperature.

**Standard superheat setting**

Charge	Refrigerant	Conditions of setting			Setting Nominal static superheat (SS), K	Given Nominal opening superheat (OS), K *)	
		Inlet pressure into valve (bar)	Saturated evaporating temperature °C	Bulb temperature °C			
Liquid (no MOP)	R 134a	7.6	-3.3	±0	3.3	2.7	
	R 22	8.6				3.0	
	R 407C					4.4	
	R 404A						2.7
	R 507						
Liquid (heat pumps)	R 22	7.6	-3.3	±0	3.3	3.0	
MOP 3.3 bar	R 134a	7.6	-3.3	±0	3.3	3.0	
MOP 6.4 bar	R 22	8.6	-22.2	-17.8	4.4	4.0	
MOP 2.3 bar	R 407C						
	R 404A						
MOP 12.9 bar	R 507	18.9	-23.1	-17.8	5.3	3.0	
	R 410A	18.9	-3.3	±0	3.3		

\*) The given opening superheats valid when the capacity of selected valve is equal to the capacity of system at design / operating conditions.

Note : All given pressures are gauge pressure.

### Dimensioning of Thermo®-Expansion Valves

To apply proper Thermo®-Expansion Valves on a system, the following design conditions must be available:

- Cooling capacity ( $Q_0$ )
- Effective pressure differential across TXV ( $\Delta p$ )
- Evaporating temperature / pressure
- Lowest possible condensing temperature / pressure
- Liquid temperature at the inlet of TXV
- Refrigerant

To facilitate valve dimensioning for other than the standard conditions ALCO offers an **Excel based Selection Tool**. This can be downloaded from [www.emersonclimate.eu](http://www.emersonclimate.eu).

Otherwise the following formula has to be used:

Cooling capacity $\times K_{\Delta p} \times K_t =$ Nominal capacity of TXV
---

- Select  $K_t$ -factor according to refrigerant, liquid and evaporating temperature from tables on pages 10-12.
- Determine effective pressure differential across the Thermo®-Expansion Valve using condensing pressure, subtract evaporating pressure and all other possible pressure losses. Select  $K_{\Delta p}$ -factor from tables on pages 10-12.

#### Example 1

A valve has to be selected for the following conditions:

- |                                   |        |
|-----------------------------------|--------|
| • Refrigerant                     | R 134a |
| • System cooling capacity         | 6 kW   |
| • Evaporating temperature         | -10°C  |
| • Lowest condensing temperature   | +25°C  |
| • Liquid temperature              | +20°C  |
| • Valve with adjustable superheat |        |

Calculation:


1. Theoretical pressure differential:  
 Condensing pressure  $P_c = 5.65$  bar at +25°C  
 Evaporating pressure  $P_0 = 1.01$  bar at -10°C  
 Differential pressure  $P_c - P_0 = 5.65 - 1.01 = 4.64$  bar
2. Pressure losses:  
 across distributor = 1.0 bar  
 in piping, solenoid valve, drier, sight glass, fitting, etc. = 0.84 bar  
 Total pressure losses = 1 + 0.84 = 1.84 bar
3. Effective pressure differential across valve:  
 $4.64 - 1.84 = 2.8$  bar
4. Correction factors:  
 Correction factor  $K_{\Delta p}$  for the pressure differential 2.8 bar from table on page 13 for R 134a  
 $\Delta p = 2.8$   **$K_{\Delta p} = 1.5$**   
 Correction factor  $K_t$  for liquid and evaporating temperature from table on page 13 for R 134a at +20°C / -10°C  **$K_t = 0.88$**
5. Calculation of nominal capacity  $Q_0 \times K_{\Delta p} \times K_t = Q_n$   
 $6.0 \times 1.5 \times 0.88 = 7.92$  kW.  
 You can select the valve from table on page 6.

**It is a TX3-M26 with a nominal capacity of 8.3 kW.**

### Dimensioning of Thermo®-Expansion Valves for systems with refrigerant R 407C

As opposed to single substances (e.g. R 22, R 134a etc.) where the phase change takes place at a constant temperature / pressure, the evaporation and condensation of zeotropic blend R407C is in a "gliding" form (e.g. at a constant pressure the temperature varies within a certain range) through evaporators and condensers.

The evaporating / condensing pressure must be determined at saturated temperatures (bubble / dew points) for dimensioning of Thermo®-Expansion Valves.

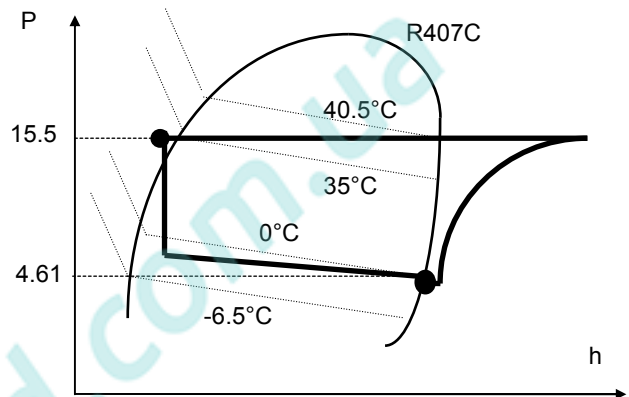

#### Example 2

- |  |        |
|--|--------|
| • Refrigerant                                      | R 407C |
| • System cooling capacity                          | 13 kW  |
| • Evaporating temperature (saturated vapour)       | 0°C    |
| • Lowest condensing temperature (saturated liquid) | +35°C  |
| • Liquid temperature                               | +34°C  |
| • Non-adjustable valve with MOP                    |        |

Calculation:

1. Theoretical pressure differential:  
 Differential pressure is  $P_c - P_0 = 15.5 - 4.61 = 10.89$  bar
2. Pressure losses:  
 across evaporator = 0.3 bar  
 in piping, solenoid valve, drier, sight glass, fitting, etc. = 1.2 bar  
 Total pressure losses = 0.3 + 1.2 = 1.5 bar
3. Effective pressure differential across valve:  
 $10.89 - 1.5 = 9.39$  bar
4. Correction factors:  
 Correction factor  $K_{\Delta p}$  for the pressure differential 9.39 bar from table on page 11 for R 407C  
 $\Delta p = 9.39$   **$K_{\Delta p} = 1.09$**   
 Correction factor  $K_t$  for liquid and evaporating temperature from table on page 11 for R 407C at +34°C / 0°C  **$K_t = 0.98$**
5. Calculation of nominal capacity  $Q_0 \times K_{\Delta p} \times K_t = Q_n$   
 $13 \times 1.09 \times 0.98 = 13.88$

You can select the valve from table on page 6.

**It is a TX3-N37 with a nominal capacity of 14.2 kW.**

**Selection table**

Refrigerant	Nominal capacity kW	without MOP		with MOP *)		Connection size	
		Type	Part No.	Type	Part No.	Equalizer	Inlet x Outlet
<b>R 134a</b>	0,6	TX3-M01	801765M	TX3-M11	801777M	Internal	1/4" x 3/8"
	1,8	TX3-M02	801766M	TX3-M12	801778M	Internal	1/4" x 3/8"
	2,8	TX3-M03	801767M	TX3-M13	801779M	Internal	1/4" x 3/8"
	4,0	TX3-M04	801768M			Internal	3/8" x 1/2"
	1,8	TX3-M22	801769M	TX3-M32	801781M	Ext. 1/4"	1/4" x 3/8"
	2,8	TX3-M23	801770M	TX3-M33	801782M	Ext. 1/4"	1/4" x 3/8"
	4,0	TX3-M24	801771M	TX3-M34	801783M	Ext. 1/4"	3/8" x 1/2"
	6,1	TX3-M25	801772M	TX3-M35	801784M	Ext. 1/4"	3/8" x 1/2"
	8,3	TX3-M26	801773M	TX3-M36	801785M	Ext. 1/4"	3/8" x 1/2"
	10,2	TX3-M27	801774M	TX3-M37	801786M	Ext. 1/4"	1/2" x 5/8"
	12,1	TX3-M28	801775M	TX3-M38	801787M	Ext. 1/4"	1/2" x 5/8"
16,5	TX3-M29	801776M	TX3-M39	801788M	Ext. 1/4"	1/2" x 5/8"	
<b>R 22</b>	0,8			TX3-H11	801730M	Internal	1/4" x 3/8"
	2,3			TX3-H12	801731M	Internal	1/4" x 3/8"
	3,6	TX3-H03	801728M	TX3-H13	801732M	Internal	1/4" x 3/8"
	5,2	TX3-H04	801729M	TX3-H14	801733M	Internal	3/8" x 1/2"
	0,8	TX3-H21	801738M			Ext. 1/4"	1/4" x 3/8"
	2,3	TX3-H22	801739M			Ext. 1/4"	1/4" x 3/8"
	3,6	TX3-H23	801740M	TX3-H33	801749M	Ext. 1/4"	1/4" x 3/8"
	5,2	TX3-H24	801741M	TX3-H34	801750M	Ext. 1/4"	3/8" x 1/2"
	7,8	TX3-H25	801742M	TX3-H35	801751M	Ext. 1/4"	3/8" x 1/2"
	10,7	TX3-H26	801743M	TX3-H36	801752M	Ext. 1/4"	3/8" x 1/2"
	13,1	TX3-H27	801744M	TX3-H37	801753M	Ext. 1/4"	1/2" x 5/8"
15,6	TX3-H28	801745M	TX3-H38	801754M	Ext. 1/4"	1/2" x 5/8"	
21,3	TX3-H29	801746M	TX3-H39	801755M	Ext. 1/4"	1/2" x 5/8"	
<b>R 407C</b>	0,9	TX3-N01	801813M			Internal	1/4" x 3/8"
	2,5	TX3-N02	801814M	TX3-N12	801827M	Internal	1/4" x 3/8"
	3,9	TX3-N03	801815M	TX3-N13	801828M	Internal	1/4" x 3/8"
	5,6			TX3-N14	801829M	Internal	3/8" x 1/2"
	0,9	TX3-N21	801817M			Ext. 1/4"	1/4" x 3/8"
	2,5	TX3-N22	801818M	TX3-N32	801831M	Ext. 1/4"	1/4" x 3/8"
	3,9	TX3-N23	801819M	TX3-N33	801832M	Ext. 1/4"	1/4" x 3/8"
	5,6	TX3-N24	801820M	TX3-N34	801833M	Ext. 1/4"	3/8" x 1/2"
	8,4	TX3-N25	801821M	TX3-N35	801834M	Ext. 1/4"	3/8" x 1/2"
	11,6	TX3-N26	801822M	TX3-N36	801835M	Ext. 1/4"	3/8" x 1/2"
	14,2	TX3-N27	801823M	TX3-N37	801836M	Ext. 1/4"	1/2" x 5/8"
	16,9	TX3-N28	801824M	TX3-N38	801837M	Ext. 1/4"	1/2" x 5/8"
	23,0	TX3-N29	801825M	TX3-N39	801838M	Ext. 1/4"	1/2" x 5/8"

The nominal capacity (Qn) is based on the following conditions:

Refrigerant	Evaporating temperature	Condensing temperature	Subcooling
R 22, R 134a, R 404A, R 410A, R 507	+4°C	+38°C	1K
R 407C	+4°C dew point	+38°C bubble / +43°C dew point	

Valve selection for other operating conditions see pages 5 and 10 to 13.

\*) see table 2 on page 2 for MOP values.

**Selection table**

Refrigerant	Nominal capacity kW	without MOP		with MOP *)		Connection size	
		Type	Part No.	Type	Part No.	Equalizer	Inlet x Outlet
<b>R 404A</b> <b>R 507</b>	0,6	TX3-S21	801865M			Ext. 1/4"	1/4" x 3/8"
	1,6	TX3-S22	801866M	TX3-S32	801875M	Ext. 1/4"	1/4" x 3/8"
	2,5	TX3-S23	801867M			Ext. 1/4"	1/4" x 3/8"
	3,7	TX3-S24	801868M	TX3-S34	801877M	Ext. 1/4"	3/8" x 1/2"
	5,5	TX3-S25	801869M			Ext. 1/4"	3/8" x 1/2"
	7,6	TX3-S26	801870M	TX3-S36	801879M	Ext. 1/4"	3/8" x 1/2"
	9,2	TX3-S27	801871M			Ext. 1/4"	1/2" x 5/8"
	11,0	TX3-S28	801872M			Ext. 1/4"	1/2" x 5/8"
	15,0	TX3-S29	801873M	TX3-S39	801882M	Ext. 1/4"	1/2" x 5/8"
<b>R 410A</b>	2,8			TX3-Z32	801942M	Ext. 1/4"	1/4" x 3/8"
	4,3			TX3-Z33	801943M	Ext. 1/4"	1/4" x 3/8"
	6,3			TX3-Z34	801944M	Ext. 1/4"	3/8" x 1/2"
	9,4			TX3-Z35	801945M	Ext. 1/4"	3/8" x 1/2"
	12,9			TX3-Z36	801946M	Ext. 1/4"	3/8" x 1/2"
	15,8			TX3-Z37	801947M	Ext. 1/4"	1/2" x 5/8"
	18,8			TX3-Z38	801948M	Ext. 1/4"	1/2" x 5/8"

The nominal capacity (Qn) is based on the following conditions:

Refrigerant	Evaporating temperature	Condensing temperature	Subcooling
R 22, R 134a, R 404A, R 410A, R 507	+4°C	+38°C	1K
R 407C	+4°C dew point	+38°C bubble / +43°C dew point	

Valve selection for other operating conditions see pages 5 and 10 to 13.

\*) see table 2 on page 2 for MOP values.

**Selection table for Heat Pump Applications**

Refrigerant	Nominal capacity kW	Adjustable with internal check valve and special liquid charge for heat pump applications				Connection size	
		without MOP				Equalizer	Inlet x Outlet
		Type	Part No.				
<b>R 407C</b>	0,9	TX3-N61	806799M			Ext. 1/4"	1/4" x 3/8"
	2,5	TX3-N62	806800M			Ext. 1/4"	1/4" x 3/8"
	3,9	TX3-N63	806801M			Ext. 1/4"	1/4" x 3/8"
	5,6	TX3-N64	806802M			Ext. 1/4"	3/8" x 1/2"
	8,4	TX3-N65	806803M			Ext. 1/4"	3/8" x 1/2"
	11,6	TX3-N66	806804M			Ext. 1/4"	3/8" x 1/2"
	14,2	TX3-N67	806805M			Ext. 1/4"	1/2" x 5/8"
	16,9	TX3-N68	806806M			Ext. 1/4"	1/2" x 5/8"
	23,0	TX3-N69	806807M			Ext. 1/4"	1/2" x 5/8"

The nominal capacity (Qn) is based on the following conditions:

Refrigerant	Evaporating temperature	Condensing temperature	Subcooling
R 407C	+4°C dew point	+38°C bubble / +43°C dew point	1 K

Valve selection for other operating conditions see pages 5 and 13.

**Determining of pressure drop across internal check valve**

		Reverse flow liquid capacity of internal check valve										
		R 407C, kW										
Pressure drop (bar)	Evaporating temperature °C	Liquid temperature °C										
		10	15	20	25	30	35	40	45	50	55	60
0,2	-20	8,6	8,2	7,8	7,5	7,2	6,8	6,5	6,2	5,8	5,4	5,1
	-10	8,7	8,4	8,1	7,7	7,3	7,0	6,7	6,3	5,9	5,6	5,3
	0	8,9	8,6	8,2	7,9	7,5	7,2	6,8	6,5	6,1	5,8	5,4
	10	9,0	8,7	8,4	8,0	7,6	7,3	7,0	6,6	6,3	5,9	5,6
0,4	-20	12,8	12,2	11,7	11,2	10,7	10,2	9,8	9,2	8,7	8,2	7,6
	-10	13,0	12,5	12,1	11,6	11,0	10,5	10,0	9,5	8,9	8,4	7,9
	0	13,3	12,8	12,2	11,8	11,2	10,7	10,2	9,8	9,2	8,6	8,1
	10	13,5	13,0	12,5	12,0	11,4	11,0	10,4	9,9	9,4	8,8	8,4
0,6	-20	17,1	16,3	15,6	14,9	14,3	13,6	13,0	12,3	11,6	10,9	10,2
	-10	17,3	16,7	16,1	15,4	14,6	14,0	13,4	12,6	11,9	11,2	10,6
	0	17,8	17,1	16,3	15,8	14,9	14,3	13,6	13,0	12,2	11,5	10,8
	10	18,0	17,3	16,7	16,0	15,3	14,6	13,9	13,2	12,5	11,8	11,1
0,8	-20	18,8	17,9	17,1	16,4	15,7	15,0	14,3	13,5	12,7	11,9	11,2
	-10	19,0	18,3	17,7	16,9	16,0	15,4	14,7	13,9	13,1	12,3	11,6
	0	19,5	18,8	17,9	17,3	16,4	15,7	15,0	14,3	13,4	12,6	11,8
	10	19,7	19,0	18,3	17,5	16,7	16,0	15,2	14,5	13,8	12,9	12,2
1	-20	21,4	20,4	19,5	18,7	17,9	17,0	16,3	15,4	14,5	13,6	12,7
	-10	21,7	20,9	20,2	19,3	18,3	17,6	16,7	15,8	14,9	14,0	13,2
	0	22,2	21,4	20,4	19,7	18,7	17,9	17,0	16,3	15,3	14,4	13,5
	10	22,5	21,7	20,9	19,9	19,1	18,3	17,4	16,6	15,7	14,7	13,9
1,2	-20	23,5	22,4	21,5	20,5	19,7	18,7	17,9	16,9	16,0	15,0	14,0
	-10	23,8	23,0	22,2	21,2	20,1	19,3	18,4	17,4	16,4	15,4	14,5
	0	24,4	23,5	22,4	21,7	20,5	19,7	18,7	17,9	16,8	15,8	14,9
	10	24,8	23,8	23,0	21,9	21,0	20,1	19,1	18,2	17,2	16,2	15,3
1,4	-20	25,7	24,5	23,4	22,4	21,5	20,4	19,5	18,5	17,4	16,3	15,3
	-10	26,0	25,1	24,2	23,1	21,9	21,1	20,1	19,0	17,8	16,8	15,8
	0	26,7	25,7	24,5	23,7	22,4	21,5	20,4	19,5	18,3	17,3	16,2
	10	27,0	26,0	25,1	23,9	22,9	21,9	20,9	19,9	18,8	17,7	16,7
1,6	-20	27,3	26,0	24,9	23,8	22,9	21,7	20,7	19,6	18,5	17,4	16,2
	-10	27,7	26,7	25,7	24,6	23,3	22,4	21,3	20,2	19,0	17,9	16,8
	0	28,4	27,3	26,0	25,2	23,8	22,9	21,7	20,7	19,5	18,4	17,2
	10	28,7	27,7	26,7	25,5	24,3	23,3	22,2	21,1	20,0	18,8	17,8
1,8	-20	28,8	27,4	26,2	25,1	24,1	22,9	21,9	20,7	19,5	18,3	17,1
	-10	29,1	28,1	27,1	25,9	24,6	23,6	22,5	21,3	20,0	18,9	17,7
	0	29,9	28,8	27,4	26,5	25,1	24,1	22,9	21,9	20,5	19,3	18,2
	10	30,3	29,1	28,1	26,8	25,7	24,6	23,4	22,3	21,1	19,8	18,7

1. Select the liquid temperature.
2. Go vertically to find a capacity equal to the capacity of the system.
3. Read the corresponding pressure drop.



**Example 3 for heat pump applications**



A heat pump with following design conditions:

**Cooling mode**

- Cooling capacity, R 407C 9,8 kW
- Condensing temperature +40°C
- Evaporating temperature +5°C
- TXV<sub>2</sub> with internal check valve (CV<sub>2</sub>)

**Heating mode**

- Heating capacity, R 407C 5.8 kW
- Condensing temperature +30°C
- Evaporating temperature -10°C
- TXV<sub>1</sub> with internal check valve (CV<sub>1</sub>)

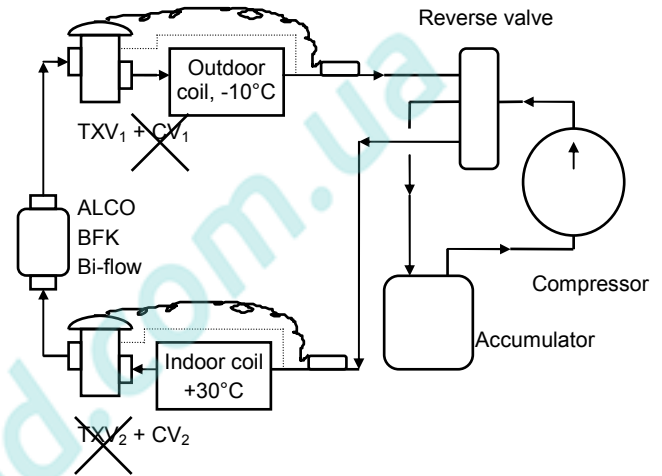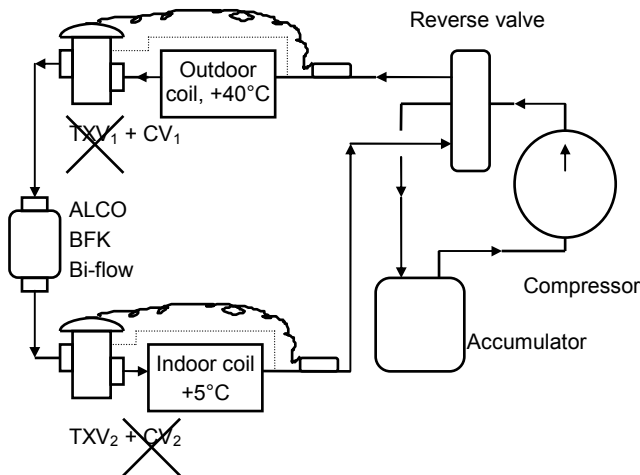

1. Determine pressure drop across check valve CV<sub>1</sub> from table on page 8  
at +40°C / +5°C CV<sub>1</sub> ≤ 0.4 bar
2. Theoretical pressure differential:  
Condensing pressure Pc = 16.45 bar at +40°C  
Evaporating pressure P<sub>0</sub> = 4.47 bar at +5°C  
Differential pressure Pc - P<sub>0</sub> = 16.45 - 4.47 = 11.98 bar
3. Pressure losses:  
Across check valve CV<sub>1</sub> = 0.4 bar  
Others - in piping, drier, sight glass, fitting, etc. = 0.8 bar  
Total pressure losses = 0.4 + 0.8 = 1.2 bar
4. Effective pressure differential across valve:  
11.98 - 1.2 = 10.78 bar
5. Correction factors:  
Correction factor K<sub>Δp</sub> for the pressure differential 10.78 bar from table on page 10 for R 407C  
Δp = 10.78 K<sub>Δp</sub> = 1.01  
Correction factor K<sub>t</sub> for liquid and evaporating temperature from table on page 10 for R 407C  
at +40°C / +5°C K<sub>t</sub> = 1.02
6. Calculation of nominal capacity Q<sub>0</sub> x K<sub>Δp</sub> x K<sub>t</sub> = Q<sub>n</sub>  
9.8 x 1.01 x 1.02 = **10.1 kW**

1. Determine pressure drop across check valve CV<sub>2</sub> from table on page 8  
at +30°C / -10°C CV<sub>2</sub> ≤ 0.2 bar
2. Theoretical pressure differential:  
Condensing pressure Pc = 12.56 bar at +30°C  
Evaporating pressure P<sub>0</sub> = 2.20 bar at -10°C  
Differential pressure Pc - P<sub>0</sub> = 12.56 - 2.20 = 10.26 bar
3. Pressure losses:  
Across check valve CV<sub>2</sub> = 0.2 bar  
Others - in piping, drier, sight glass, fitting, etc. = 0.8 bar  
Total pressure losses = 0.2 + 0.8 = 1.0 bar
4. Effective pressure differential across valve:  
10.26 - 1.0 = 9.26 bar
5. Correction factors:  
Correction factor K<sub>Δp</sub> for the pressure differential 9.26 bar from table on page 10 for R 407C  
Δp = 9.26 K<sub>Δp</sub> = 1.11  
Correction factor K<sub>t</sub> for liquid and evaporating temperature from table on page 10 for R 407C  
at +30°C / -10°C K<sub>t</sub> = 0.95
6. Calculation of nominal capacity Q<sub>0</sub> x K<sub>Δp</sub> x K<sub>t</sub> = Q<sub>n</sub>  
5.8 x 1.11 x 0.95 = **6.12 kW**

Select the valve from the table on page 8.

**It is a TX3-N66 with a nominal capacity of 11.6 kW.**  
(TXV<sub>2</sub> + CV<sub>2</sub> = TX3-N66)

**It is a TX3-N65 with a nominal capacity of 8.4 kW.**  
(TXV<sub>1</sub> + CV<sub>1</sub> = TX3-N65)

**Correction Tables**

Liquid temperature entering valve °C	<b>R22</b>															
	<b>Correction factor <math>K_t</math></b>															
	Evaporating temperature °C															
		+20	+15	+10	+5	0	-5	-10	-15	-20	-25	-30	-35	-40	-45	
+60		1,24	1,25	1,26	1,28	1,30	1,31	1,38	1,58	1,84	2,16	2,56	3,04	3,55	4,23	
+55		1,16	1,17	1,19	1,20	1,22	1,23	1,29	1,42	1,72	2,02	2,39	2,83	3,30	3,94	
+50		1,10	1,11	1,12	1,13	1,15	1,16	1,21	1,39	1,62	1,89	2,24	2,66	3,10	3,68	
+45		1,04	1,05	1,06	1,07	1,08	1,10	1,15	1,31	1,52	1,79	2,11	2,50	2,91	3,46	
+40		0,99	1,00	1,01	1,02	1,03	1,04	1,09	1,24	1,45	1,69	2,00	2,37	2,75	3,27	
+35		0,94	0,95	0,96	0,97	0,98	0,99	1,03	1,18	1,37	1,61	1,89	2,24	2,60	3,09	
+30		0,90	0,91	0,92	0,93	0,94	0,95	0,99	1,13	1,31	1,55	1,83	2,13	2,47	2,93	
+25		0,86	0,87	0,88	0,89	0,89	0,90	0,94	1,08	1,25	1,46	1,72	2,03	2,36	2,80	
+20		0,83	0,83	0,84	0,85	0,86	0,87	0,90	1,03	1,19	1,40	1,64	1,94	2,25	2,66	
+15			0,80	0,81	0,81	0,82	0,83	0,87	0,99	1,14	1,34	1,57	1,86	2,15	2,55	
+10				0,78	0,78	0,79	0,80	0,83	0,95	1,10	1,28	1,51	1,78	2,06	2,44	
+5					0,75	0,76	0,77	0,80	0,91	1,06	1,23	1,45	1,71	1,98	2,34	
0						0,73	0,74	0,77	0,88	1,02	1,19	1,39	1,65	1,90	2,25	
-5							0,71	0,74	0,85	0,98	1,14	1,34	1,58	1,83	2,17	
-10								0,72	0,82	0,95	1,10	1,30	1,53	1,77	2,09	
<b>Correction factor <math>K_{\Delta p}</math></b>																
$\Delta p$ (bar)	0,5	1	1,5	2	2,5	3	3,5	4	4,5	5	5,5	6	6,5	7	8	9
$K_{\Delta p}$	4,25	3,00	2,46	2,13	1,90	1,74	1,61	1,50	1,42	1,35	1,28	1,23	1,18	1,14	1,06	1,00
$\Delta p$ (bar)	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25
$K_{\Delta p}$	0,95	0,91	0,87	0,83	0,80	0,78	0,75	0,73	0,71	0,69	0,67	0,66	0,64	0,63	0,61	0,60

Liquid temperature entering valve °C	<b>R407C</b>															
	<b>Correction factor <math>K_t</math></b>															
	Evaporating temperature °C															
		+20	+15	+10	+5	0	-5	-10	-15	-20	-25					
+55		1,23	1,26	1,28	1,31	1,34	1,37	1,40	1,63	1,98	2,42					
+50		1,13	1,15	1,17	1,19	1,22	1,24	1,27	1,48	1,79	2,18					
+45		1,05	1,06	1,08	1,10	1,12	1,14	1,17	1,35	1,64	2,00					
+40		0,98	0,99	1,01	1,02	1,04	1,06	1,08	1,25	1,52	1,84					
+35		0,92	0,93	0,94	0,96	0,98	0,99	1,01	1,17	1,41	1,71					
+30		0,87	0,88	0,89	0,90	0,92	0,93	0,95	1,10	1,32	1,60					
+25		0,82	0,83	0,84	0,85	0,87	0,88	0,90	1,03	1,25	1,51					
+20		0,78	0,79	0,80	0,81	0,82	0,84	0,85	0,98	1,18	1,43					
+15			0,75	0,76	0,77	0,78	0,80	0,81	0,93	1,12	1,35					
+10				0,73	0,74	0,75	0,76	0,77	0,89	1,07	1,29					
+5					0,71	0,72	0,73	0,74	0,85	1,02	1,23					
0						0,69	0,70	0,71	0,81	0,98	1,18					
<b>Correction factor <math>K_{\Delta p}</math></b>																
$\Delta p$ (bar)	0,5	1	1,5	2	2,5	3	3,5	4	4,5	5	5,5	6	6,5	7	8	9
$K_{\Delta p}$	4,78	3,33	2,72	2,36	2,11	1,92	1,78	1,67	1,57	1,49	1,42	1,36	1,31	1,26	1,18	1,11
$\Delta p$ (bar)	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25
$K_{\Delta p}$	1,05	1,01	0,96	0,92	0,89	0,86	0,83	0,81	0,79	0,76	0,75	0,73	0,71	0,70	0,68	0,67

# D A T A S H E E T

Liquid temperature entering valve °C	<b>R404A</b>															
	Correction factor $K_t$															
	Evaporating temperature °C															
		+20	+15	+10	+5	0	-5	-10	-15	-20	-25	-30	-35	-40	-45	
+ 55		1,38	1,42	1,46	1,50	1,55	1,61	1,68	1,96	2,36	2,83	3,43	4,16	5,12	6,34	
+ 50		1,20	1,23	1,26	1,30	1,34	1,38	1,43	1,67	1,99	2,37	2,85	3,43	4,18	5,14	
+ 45		1,07	1,10	1,12	1,15	1,18	1,22	1,26	1,46	1,74	2,05	2,46	2,95	3,57	4,35	
+ 40		0,97	0,99	1,02	1,04	1,07	1,09	1,13	1,30	1,55	1,82	2,17	2,59	3,13	3,80	
+ 35		0,90	0,91	0,93	0,95	0,97	1,00	1,02	1,18	1,40	1,64	1,96	2,33	2,80	3,38	
+ 30		0,83	0,84	0,86	0,88	0,90	0,92	0,94	1,08	1,28	1,50	1,78	2,11	2,53	3,05	
+ 25		0,77	0,79	0,80	0,82	0,83	0,85	0,87	1,00	1,18	1,39	1,64	1,94	2,32	2,79	
+ 20		0,73	0,74	0,75	0,77	0,78	0,80	0,81	0,94	1,10	1,29	1,52	1,80	2,15	2,58	
+ 15			0,70	0,71	0,72	0,73	0,75	0,76	0,88	1,03	1,21	1,42	1,68	2,00	2,40	
+ 10				0,67	0,68	0,69	0,71	0,72	0,83	0,97	1,13	1,34	1,58	1,88	2,25	
+ 5					0,65	0,66	0,67	0,68	0,78	0,92	1,07	1,26	1,49	1,77	2,11	
0						0,63	0,64	0,65	0,75	0,88	1,02	1,20	1,41	1,67	2,00	
- 5							0,61	0,62	0,71	0,83	0,97	1,14	1,34	1,59	1,90	
- 10								0,60	0,68	0,80	0,93	1,09	1,28	1,52	1,81	
Correction factor $K_{\Delta p}$																
$\Delta p$ (bar)	0,5	1	1,5	2	2,5	3	3,5	4	4,5	5	5,5	6	6,5	7	8	9
$K_{\Delta p}$	4,55	3,21	2,62	2,27	2,03	1,86	1,72	1,61	1,52	1,44	1,37	1,31	1,26	1,21	1,14	1,07
$\Delta p$ (bar)	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25
$K_{\Delta p}$	1,02	0,97	0,93	0,89	0,86	0,83	0,80	0,78	0,76	0,74	0,72	0,70	0,69	0,67	0,66	0,64

Liquid temperature entering valve °C	<b>R507</b>															
	Correction factor $K_t$															
	Evaporating temperature °C															
		+20	+15	+10	+5	0	-5	-10	-15	-20	-25	-30	-35	-40	-45	
+ 55		1,36	1,39	1,43	1,47	1,52	1,57	1,62	1,92	2,29	2,75	3,35	4,11	5,11	6,44	
+ 50		1,19	1,22	1,24	1,28	1,31	1,35	1,40	1,64	1,95	2,33	2,81	3,43	4,23	5,29	
+ 45		1,07	1,09	1,11	1,14	1,17	1,20	1,23	1,45	1,71	2,04	2,45	2,97	3,64	4,53	
+ 40		0,97	0,99	1,01	1,03	1,06	1,08	1,11	1,30	1,53	1,82	2,18	2,63	3,22	3,98	
+ 35		0,90	0,91	0,93	0,95	0,97	0,99	1,01	1,18	1,39	1,65	1,97	2,37	2,89	3,56	
+ 30		0,83	0,85	0,86	0,88	0,89	0,91	0,93	1,09	1,28	1,51	1,80	2,17	2,63	3,23	
+ 25		0,78	0,79	0,80	0,82	0,83	0,85	0,87	1,01	1,18	1,40	1,66	1,99	2,42	2,97	
+ 20		0,73	0,74	0,75	0,77	0,78	0,79	0,81	0,94	1,10	1,30	1,54	1,85	2,24	2,74	
+ 15			0,70	0,71	0,72	0,73	0,75	0,76	0,88	1,03	1,21	1,44	1,73	2,09	2,55	
+ 10				0,67	0,68	0,69	0,70	0,72	0,83	0,97	1,14	1,35	1,62	1,95	2,38	
+ 5					0,64	0,65	0,67	0,68	0,78	0,92	1,07	1,27	1,52	1,83	2,23	
0						0,62	0,63	0,64	0,74	0,87	1,02	1,20	1,43	1,73	2,10	
- 5							0,60	0,61	0,70	0,82	0,96	1,14	1,35	1,63	1,98	
- 10								0,58	0,67	0,78	0,91	1,08	1,28	1,54	1,87	
Correction factor $K_{\Delta p}$																
$\Delta p$ (bar)	0,5	1	1,5	2	2,5	3	3,5	4	4,5	5	5,5	6	6,5	7	8	9
$K_{\Delta p}$	4,63	3,27	2,67	2,31	2,07	1,89	1,75	1,64	1,54	1,46	1,40	1,34	1,28	1,24	1,16	1,09
$\Delta p$ (bar)	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25
$K_{\Delta p}$	1,03	0,99	0,94	0,91	0,87	0,85	0,82	0,79	0,77	0,75	0,73	0,71	0,70	0,68	0,67	0,65

Liquid temperature entering valve °C	<b>R134a</b>															
	Correction factor $K_t$															
	Evaporating temperature °C															
		+20	+15	+10	+5	0	-5	-10	-15	-20	-25					
+60		1,27	1,30	1,33	1,36	1,40	1,44	1,48	1,75	2,08	2,46					
+55		1,18	1,21	1,23	1,26	1,29	1,33	1,36	1,60	1,90	2,25					
+50		1,10	1,13	1,15	1,17	1,20	1,23	1,26	1,48	1,76	2,07					
+45		1,04	1,06	1,08	1,10	1,12	1,15	1,17	1,38	1,63	1,92					
+40		0,98	0,99	1,01	1,03	1,05	1,08	1,10	1,29	1,52	1,79					
+35		0,92	0,94	0,96	0,97	0,99	1,01	1,03	1,21	1,43	1,68					
+30		0,88	0,89	0,91	0,92	0,94	0,96	0,98	1,14	1,35	1,58					
+25		0,83	0,85	0,86	0,87	0,89	0,91	0,92	1,08	1,27	1,49					
+20		0,80	0,81	0,82	0,83	0,85	0,89	0,88	1,02	1,21	1,41					
+15			0,77	0,78	0,79	0,81	0,82	0,84	0,97	1,15	1,34					
+10				0,75	0,76	0,77	0,78	0,80	0,93	1,09	1,28					
+5					0,73	0,74	0,75	0,76	0,89	1,04	1,22					
0						0,71	0,72	0,73	0,85	1,00	1,17					
-5							0,69	0,70	0,82	0,96	1,12					
-10								0,68	0,79	0,92	1,07					
Correction factor $K_{\Delta p}$																
$\Delta p$ (bar)	0,5	1	1,5	2	2,5	3	3,5	4	4,5	5	5,5	6	6,5	7	7,5	8
$K_{\Delta p}$	3,50	2,48	2,02	1,75	1,57	1,43	1,32	1,24	1,17	1,11	1,06	1,01	0,97	0,94	0,90	0,88
$\Delta p$ (bar)	8,5	9	9,5	10	10,5	11	11,5	12	13	14	15	16	17	18	19	20
$K_{\Delta p}$	0,85	0,83	0,80	0,78	0,76	0,75	0,73	0,72	0,69	0,66	0,64	0,62	0,60	0,58	0,57	0,55

Liquid temperature entering valve °C	<b>R410A</b>															
	Correction factor $K_t$															
	Evaporating temperature °C															
		+20	+15	+10	+5	0	-5	-10	-15	-20	-25	-30	-35	-40	-45	
+60		1,54	1,56	1,58	1,60	1,63	1,66	1,69	1,98	2,28	2,80	3,28	3,93	4,85	5,95	
+55		1,35	1,36	1,38	1,40	1,42	1,44	1,46	1,71	1,96	2,41	2,81	3,36	4,13	5,05	
+50		1,21	1,22	1,23	1,25	1,26	1,28	1,30	1,52	1,74	2,13	2,48	2,96	3,63	4,42	
+45		1,10	1,11	1,12	1,14	1,15	1,16	1,18	1,38	1,57	1,92	2,24	2,66	3,26	3,96	
+40		1,02	1,02	1,03	1,04	1,06	1,07	1,08	1,26	1,44	1,76	2,04	2,43	2,97	3,60	
+35		0,95	0,95	0,96	0,97	0,98	0,99	1,00	1,17	1,33	1,62	1,88	2,24	2,73	3,31	
+30		0,89	0,89	0,90	0,91	0,92	0,93	0,94	1,09	1,24	1,51	1,75	2,08	2,54	3,07	
+25		0,84	0,84	0,85	0,85	0,86	0,87	0,88	1,02	1,17	1,42	1,64	1,95	2,37	2,87	
+20		0,79	0,79	0,80	0,81	0,81	0,82	0,83	0,97	1,10	1,34	1,55	1,83	2,23	2,69	
Correction factor $K_{\Delta p}$																
$\Delta p$ (bar)		0,5	1	1,5	2	2,5	3	3,5	4	4,5	5	5,5	6	6,5	7	
$K_{\Delta p}$		5,31	3,75	3,07	2,66	2,37	2,17	2,01	1,88	1,77	1,68	1,60	1,53	1,47	1,42	
$\Delta p$ (bar)		7,5	8	8,5	9	9,5	14	15	16	17	18	19	20	21	22	
$K_{\Delta p}$		1,37	1,33	1,29	1,25	1,22	1,00	0,97	0,94	0,91	0,89	0,86	0,84	0,82	0,80	

**Technical data**

Compatibility *)	CFC, HCFC, HFC, Mineral and POE lubricants
Maximum working pressure	PS: 45 bar
Factory test pressure	PT: 48.3 bar
Burst pressure	207 bar
Medium temperature range	-45 to 120°C

Seat leakage	≤ 1% nominal capacity
Connection	ODF, copper
Charges	CFC free
Protection	salt spray test
Weight	~ 0.5 kg (individual)


\*) TX3 are not released for use with inflammable substances.

Charge	Refrigerant	Recommended evaporating temperature range °C
Liquid (no MOP)	<b>R 22, R 404A, R 507</b>	-45 to +20
Liquid (no MOP)	<b>R 134a, R 407C</b>	-25 to +20
Liquid (heat pump)	<b>R 22</b>	-35 to +20
MOP 3.3 bar	<b>R 134a</b>	-25 to +9
MOP 6.4 bar	<b>R 22</b>	-45 to +10
MOP 6.4 bar	<b>R 407C</b>	-25 to +12
MOP 2.3 bar	<b>R 404A</b>	-45 to -21
MOP 2.3 bar	<b>R 507</b>	-45 to -20
MOP 12.9 bar	<b>R 410A</b>	-30 to +17


**Shipping weights and pack quantities**

	<b>TX3 with standard setting</b>
Pack quantity	24 (no single pack)
Minimum order quantity	24
Shipping weight (pack)	12 kg

**Dimensions**

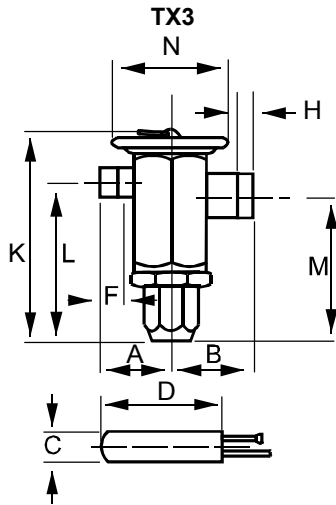

**External Equalize Configuration View**

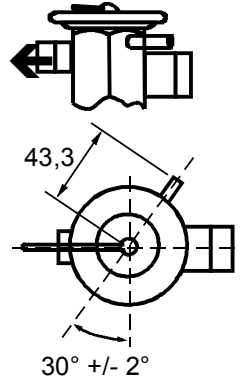

**Body:**

Type	Connection size (inch)		Roughing in dimensions (mm)							
	Inlet	Outlet	A	B	F	H	N	K	L	M
TX3-...1	1/4"	3/8"	43.3	44.1	7.9	7.9	44.5	86.5	64.7	54.4
TX3-...2	1/4"	3/8"	43.3	44.1	7.9	7.9				
TX3-...3	1/4"	3/8"	43.3	44.1	7.9	7.9				
TX3-...4	3/8"	1/2"	44.1	44.1	7.9	9.5				
TX3-...5	3/8"	1/2"	44.1	44.1	7.9	9.5				
TX3-...6	3/8"	1/2"	44.1	44.1	7.9	9.5				
TX3-...7	1/2"	5/8"	44.1	44.5	9.5	12.7				
TX3-...8	1/2"	5/8"	44.1	44.5	9.5	12.7				
TX3-...9	1/2"	5/8"	44.1	44.5	9.5	12.7				

**Bulb:**

Charge	Refrigerant	Dimensions of bulb (mm)		Capillary tube length
		D (length)	Ø C	
All charges	all	53.2	12.8	1.5 m
Special liquid charge (TX3 with check valve)	R 407C	58.7	19.2	1.5 m

EMERSON is not to be held responsible for erroneous literature regarding capacities, dimensions, applications, etc. stated herein. Products, specifications and data in this literature are subject to change without notice. The information given herein is based on technical data and tests which EMERSON believes to be reliable and which are in compliance with technical knowledge of today. It is intended only for

use by persons having the appropriate technical knowledge and skills, at their own discretion and risk. Our products are designed and adapted for fixed locations. For mobile applications failures may occur. The suitability for this has to be assured from the plant manufacturer which may include making appropriate tests.

This document replaces all earlier versions.

		<b>Phone:</b>	<b>Fax:</b>
<b>Emerson Electric GmbH &amp; Co OHG</b> <b>ALCO CONTROLS</b> <b>Postfach 1251</b> <b>Heerstraße 111</b> <b>D-71332 Waiblingen</b> <b>Germany</b> <b>Phone ...49-7151-509-0</b> <b>Fax ...49-7151-509-200</b>  <a href="http://www.emersonclimate.eu">www.emersonclimate.eu</a>	Benelux	+31 (0)77 324 0 234	+31 (0)77 324 0 235
	Germany, Austria & Switzerland	+49 (0)6109 6059 -0	+49 (0)6109 6059 40
	France, Greece, Maghreb	+33 (0)4 78 66 85 70	+33 (0)4 78 66 85 71
	Italia	+39 02 961 781	+39 02 961 788 888
	Spain & Portugal	+34 93 41 23 752	+34 93 41 24 2
	UK & Ireland	+44 (0) 1635 876 161	+44 (0) 1635 877 111
	Sweden, Denmark, Norway & Finland	+49 (0)2408 929 0	+49 (0)2408 929 528
	Eastern Europe & Turkey	+49 (0)2408 929 0	+49 (0)2408 929 525
	Poland	+48 (0)22 458 9205	+48 (0)22 458 9255
	Russia & Cis	+7 495 981 9811	+7 495 981 9816
	Balkan	+385 (0) 1560 38 75	+385 (0) 1 560 3879
	Romania	+40 364 73 11 72	+40 364 73 12 98
Ukraine	+38 44 4 92 99 24	+38 44 4 92 99 28	